











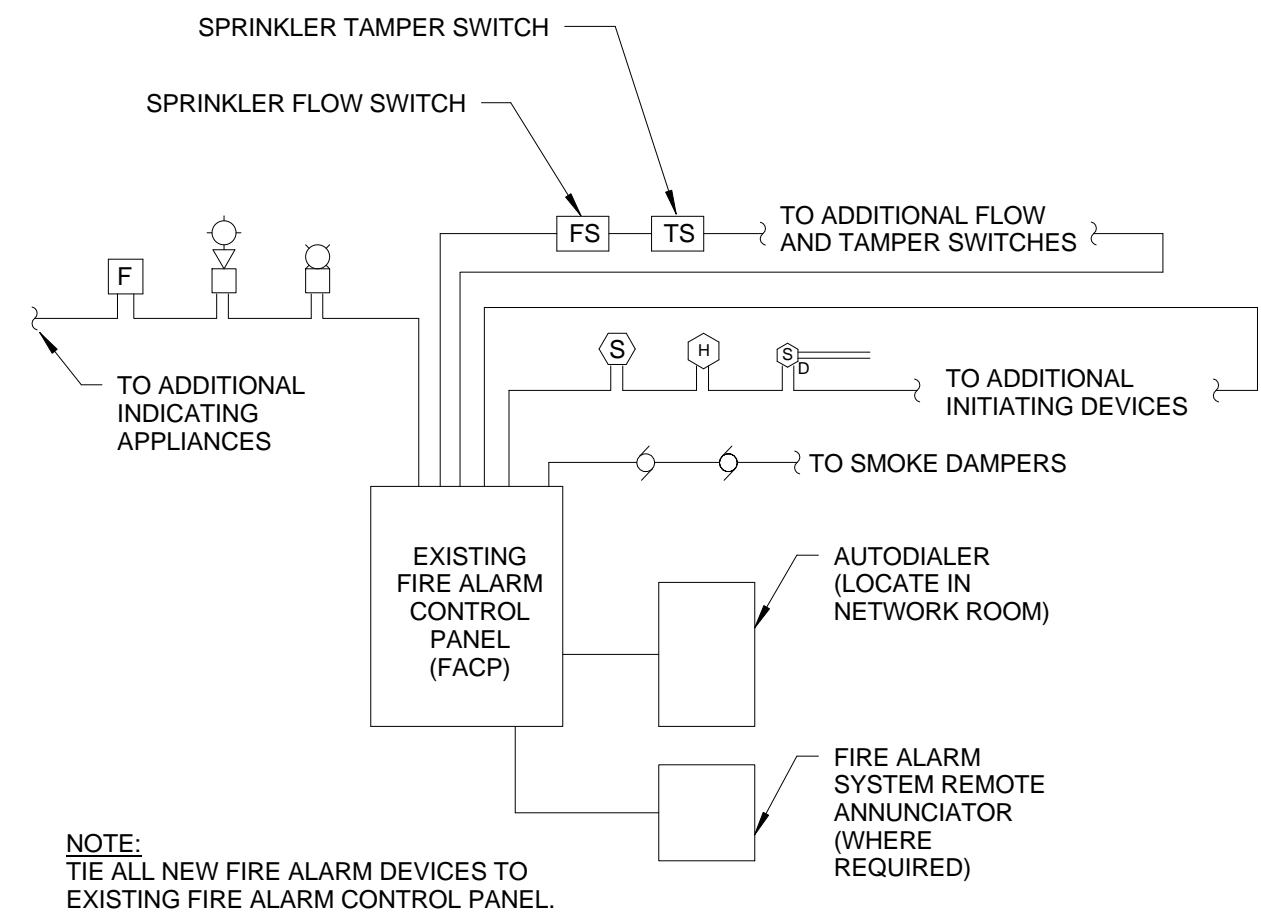


BASEMENT FIRE ALARM & LIFE SAFETY PLAN NOTES:

1. CIRCUIT ALL EXIT SIGNS ON EMERGENCY LIGHTING CIRCUIT SERVING THE SAME AREA AHEAD OF ANY SWITCHING.
2. A CORRIDOR, ROOM, OR ADJACENT SPACE WITH TWO OR MORE VISIBLE NOTIFICATION APPLIANCES WITHIN THE FIELD OF VIEW SHALL FLASH IN SYNCHRONIZATION.
3. TIE ALL NEW FIRE ALARM DEVICES INTO EXISTING FIRE ALARM PANEL.

## FIRE ALARM LEGEND

SYMBOL	DESCRIPTION
	FIRE ALARM HORN/STROBE LIGHT-WALL MOUNTED SUCH THAT THE ENTIRE LENS IS NOT LESS THAN 80° AND NOT GREATER THAN 96° AFF.
	FIRE ALARM STROBE LIGHT-WALL MOUNTED SUCH THAT THE ENTIRE LENS IS NOT LESS THAN 80° AND NOT GREATER THAN 96° AFF.
	FIRE ALARM STROBE LIGHT-CEILING MOUNTED SUCH THAT THE ENTIRE LENS IS NOT GREATER THAN 10-0° AFF.
	FIRE ALARM HORN/STROBE LIGHT-CEILING MOUNTED SUCH THAT THE ENTIRE LENS IS NOT GREATER THAN 10-0° AFF.
	MANUAL FIRE ALARM PULL STATION TO BE LOCATED WITHIN 5'-0" OF THE EXIT DOORWAY OPENING, MIN. 42" AFF, MAX. 48" AFF.
 FACP	FIRE ALARM CONTROL PANEL
 FAA	FIRE ALARM ANNUNCIATOR
	SMOKE DETECTOR
	HEAT DETECTOR
	SMOKE DUCT DETECTOR
 FS	FLOW SWITCH
 TS	TAMPER SWITCH



2 FIRE ALARM RISER DETAIL  
N.T.S.

1 BASEMENT FIRE ALARM & LIFE SAFETY PLAN  
1/8" = 1'-0"

FULLY SPRINKLERED  
ISSUED FOR BID

		CONSULTANTS:										PROJECT MANAGER:		Project Number 3627		Scale As indicated		Drawing Title BASEMENT FIRE ALARM AND LIFE SAFETY PLAN, FIRE ALARM RISER DETAIL AND LEGEND		Project Title RENOVATE BUILDING 69		VA Project Number 542-CSI-203		Office of Facilities Management	
		Project Manager: BRAY MOONEY CONSULTING		Architect ARRAY HEALTHCARE FACILITIES SOLUTIONS		Structural Engineer: WZG, STRUCTURAL CONSULTING ENGINEERS		MER/PFP Engineer: APOGEE CONSULTING GROUP		Civil Engineer: GUIDON DESIGN		Fire Protection Consultant: HARRINGTON GROUP		Cost Estimator: BRAY MOONEY CONSULTING		Acoustic Consultant: ATLANTIC AQUATIC ENGINEERING									
		410 E. 21 STREET CHESTER, PA. 19013 Tel (610) 872-3716		3620 RENAISSANCE BLVD., SUITE 110 KING OF PRUSSIA, PA. 19406 Tel (610) 270-0599		180 W. RIDGE PIKE LIMERICK, PA. 19488 Tel (214) 329-5559		7330 CHAPEL HILL ROAD, SUITE 202 RALEIGH, NC 27606 Tel (919) 858-7400		2453 N DELAWARE STREET INDIANAPOLIS, IN 46205 Tel (317) 800-6388		7508 E INDEPENDENCE BLVD., SUITE 118 CHARLOTTE, NC 28277 Tel (704) 531-9077		410 E. 21 STREET CHESTER, PA. 19013 Tel (610) 872-3716		1623 DEEP RUN ROAD PIPERSVILLE, PA 18947 Tel (215) 766-0429		Location 1400 Black Horse Hill, Coatesville, PA		Drawing Number FA101 Dwg. 82 of 86					
Revisions		Date														Approved: Project Director		Date 1/22/2014		Checked CGS/WCM		Drawn KLC		 Department of Veterans Affairs	